

4

3

2

1

D

D

C


C

B

B

A

A

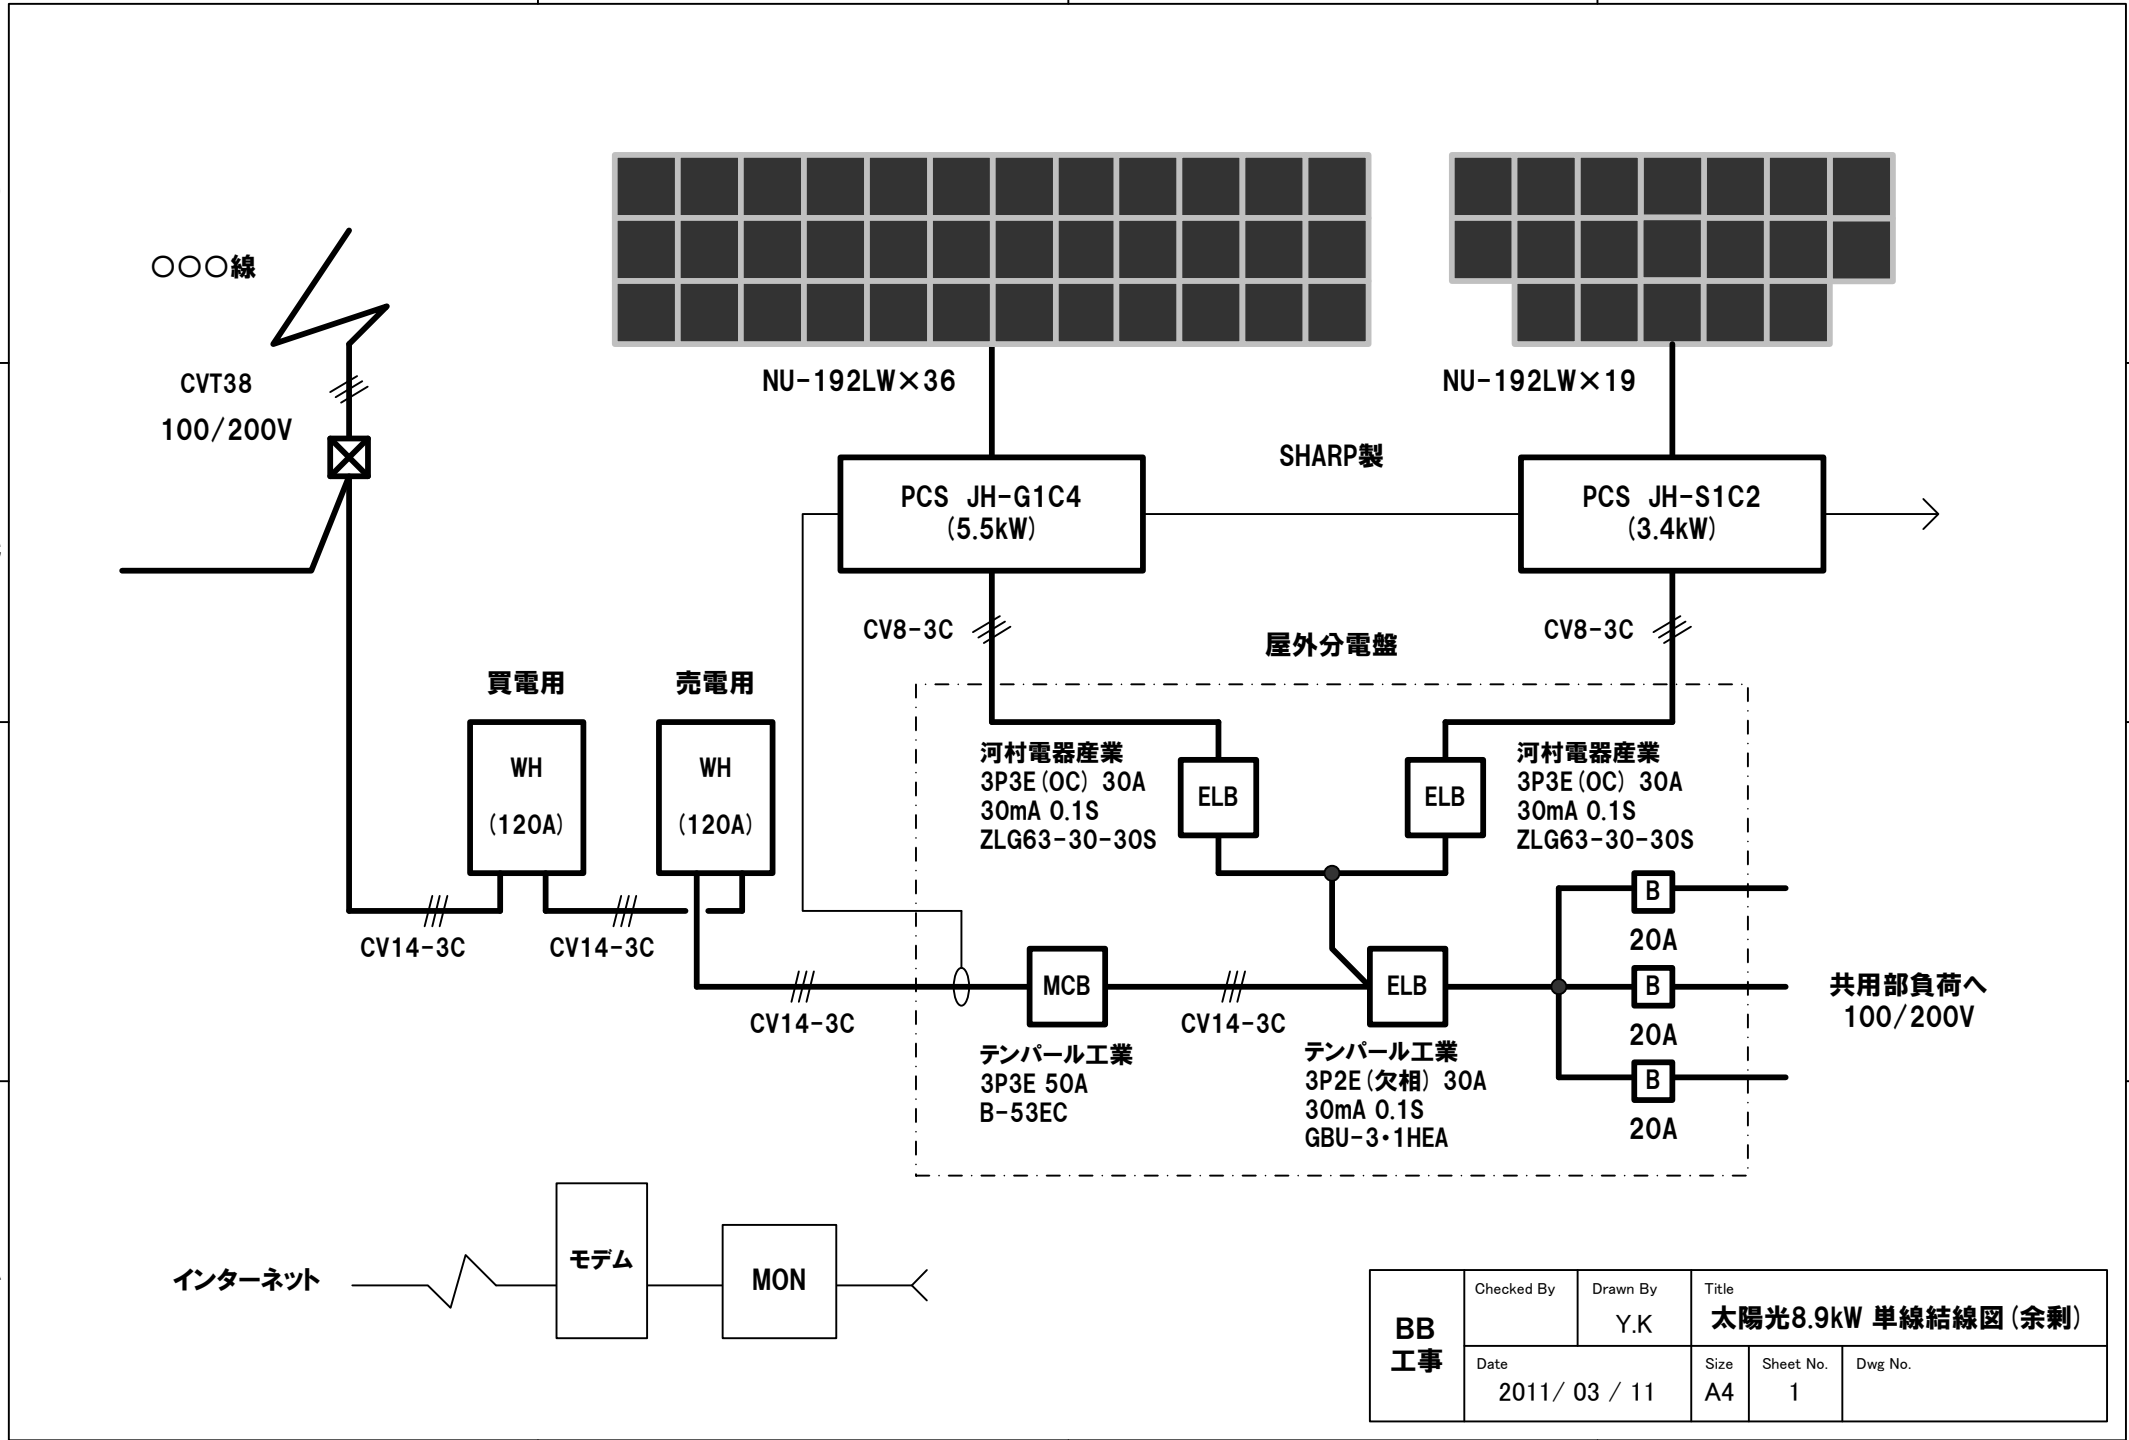

〇〇〇線

CVT38
100/200V

NU-192LW×36

NU-192LW×19

PCS JH-G1C4
(5.5kW)

SHARP製

PCS JH-S1C2
(3.4kW)

CV8-3C

CV8-3C

屋外分電盤

買電用

売電用

WH
(120A)

WH
(120A)

CV14-3C

CV14-3C

CV14-3C

CV14-3C

河村電器産業
3P3E (OC) 30A
30mA 0.1S
ZLG63-30-30S

ELB

ELB

河村電器産業
3P3E (OC) 30A
30mA 0.1S
ZLG63-30-30S

MCB

テンパール工業
3P3E 50A
B-53EC

ELB

テンパール工業
3P2E (欠相) 30A
30mA 0.1S
GBU-3・1HEA

B

20A

B

20A

B

20A

共用部負荷へ
100/200V

インターネット

モデム

MON

BB 工事	Checked By	Drawn By Y.K	Title 太陽光8.9kW 単線結線図 (余剰)		
	Date 2011/ 03 / 11	Size A4	Sheet No. 1	Dwg No.	

4

3

2

1

4

3

2

1

D

D

C





C

B


B

A

A

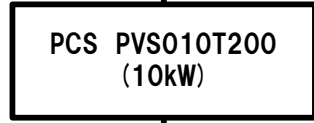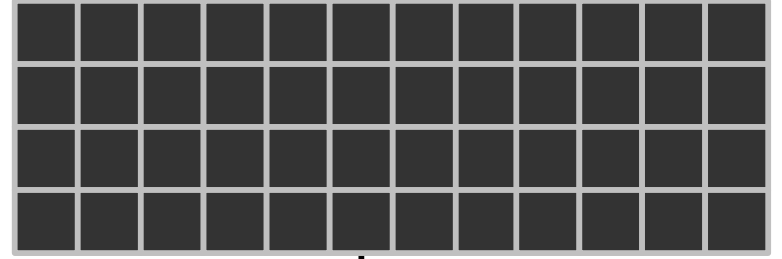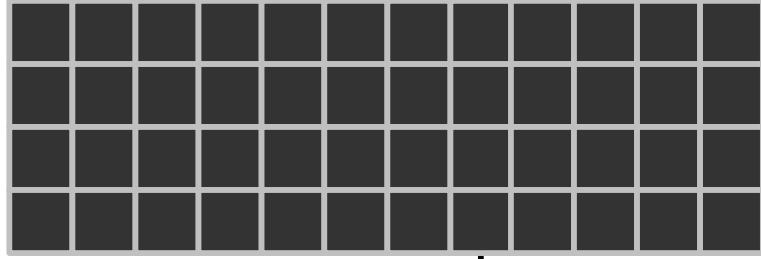

新電元製

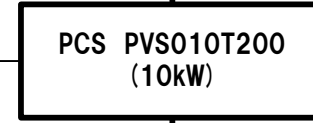


CV8-3C

屋内分電盤

CV8-3C

売電用



河村電器産業
3P3E (OC) 50A
100mA 0.1S
ZLG63-50-100S






河村電器産業
3P3E (OC) 50A
100mA 0.1S
ZLG63-50-100S



CVT22

河村電器産業
3P3E 75A
NL-103R-75M

インターネット



BB 工事	Checked By	Drawn By Y.K	Title 太陽光20kW 単線結線図(全量)		
	Date 2011/ 03 / 11	Size A4	Sheet No. 1	Dwg No.	

4

3

2

1